


OPW1 Northern Ventilation Buildings and Stack

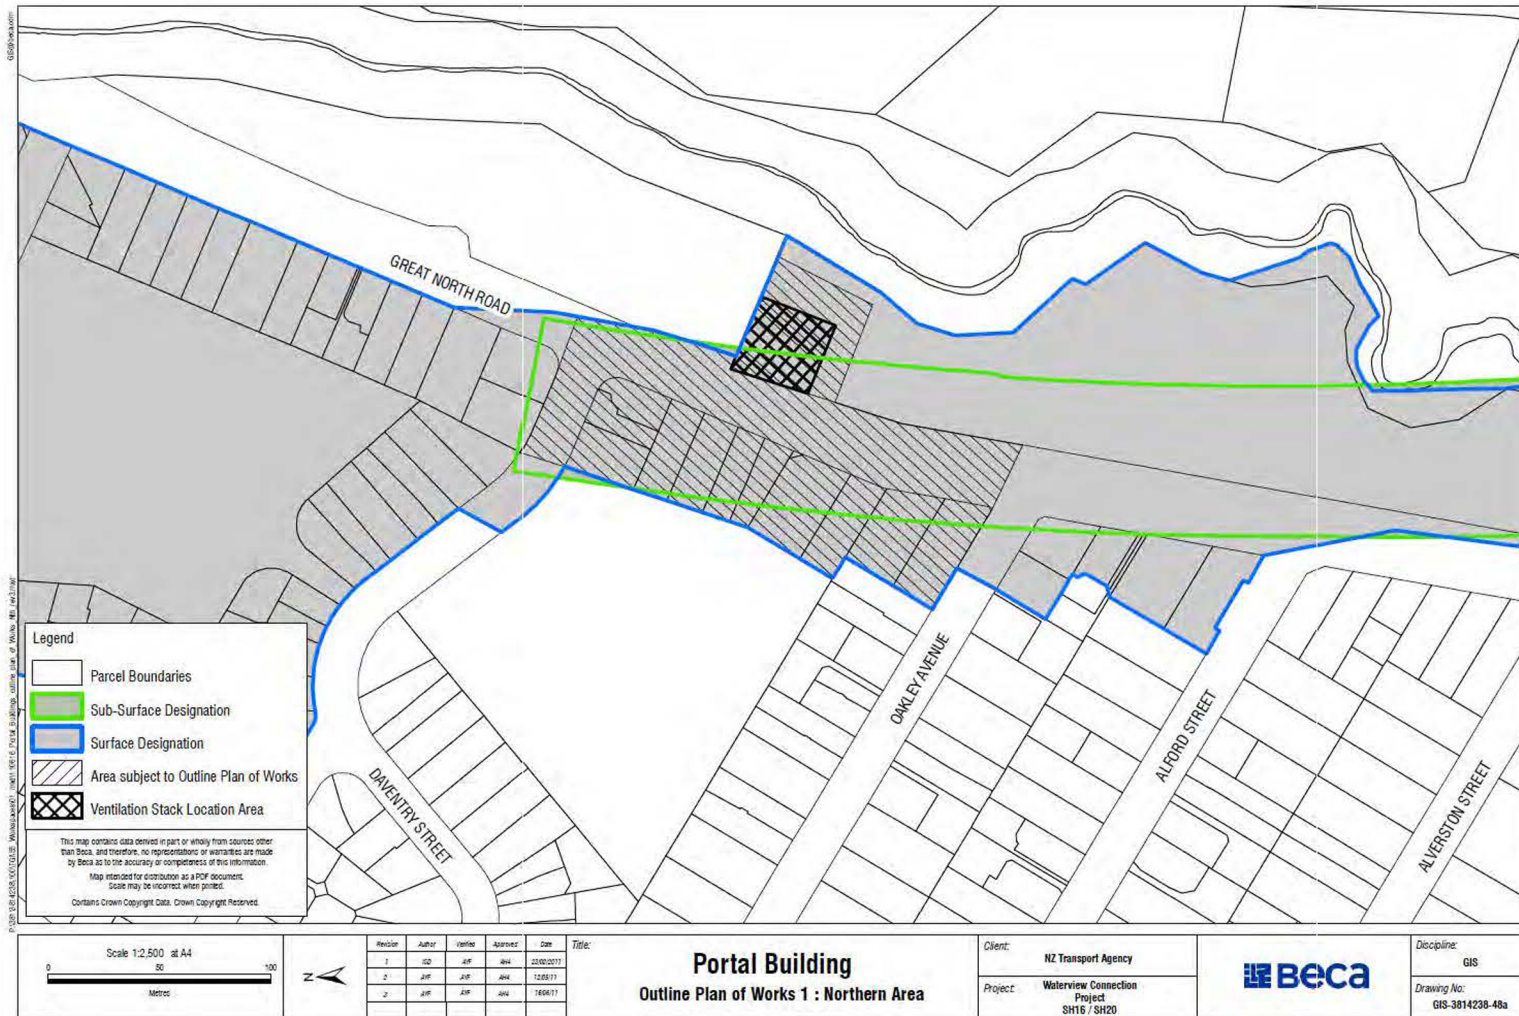

Conditions

29 June 2011