


OPTION E2

BUFFER ZONE ACROSS GREENWAY/CYCLEWAY

- * May increase due to line swing and corresponding increase in buffer zone
- Assumed to be vested with Auckland Council as public open space as part of wider movement network
- Trees in road and greenway to comply with Electricity Hazards From Trees Regulations 2003
- Fencing control required adjacent to greenway

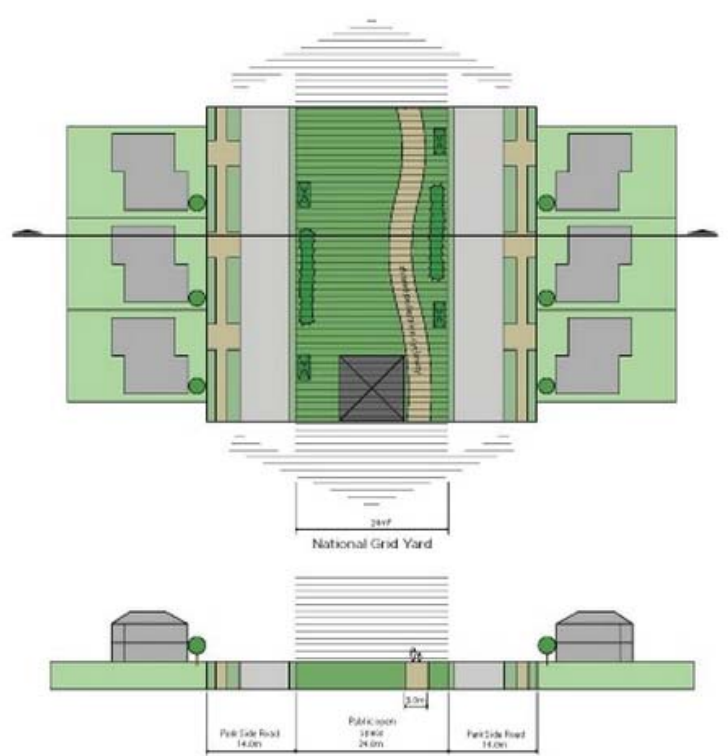

OPTION E3

BUFFER ZONE ACROSS GREENWAY/CYCLEWAY

- * May increase due to line swing and corresponding increase in buffer zone
- Assumed to be vested with Auckland Council as public open space as part of wider movement network
- Trees in road and greenway to comply with Electricity Hazards From Trees Regulations 2003
- Fencing control required adjacent to greenway

Figure 13. Possible design options for subdivision layouts within the National Grid Subdivision Corridor - Option E2 and E3